
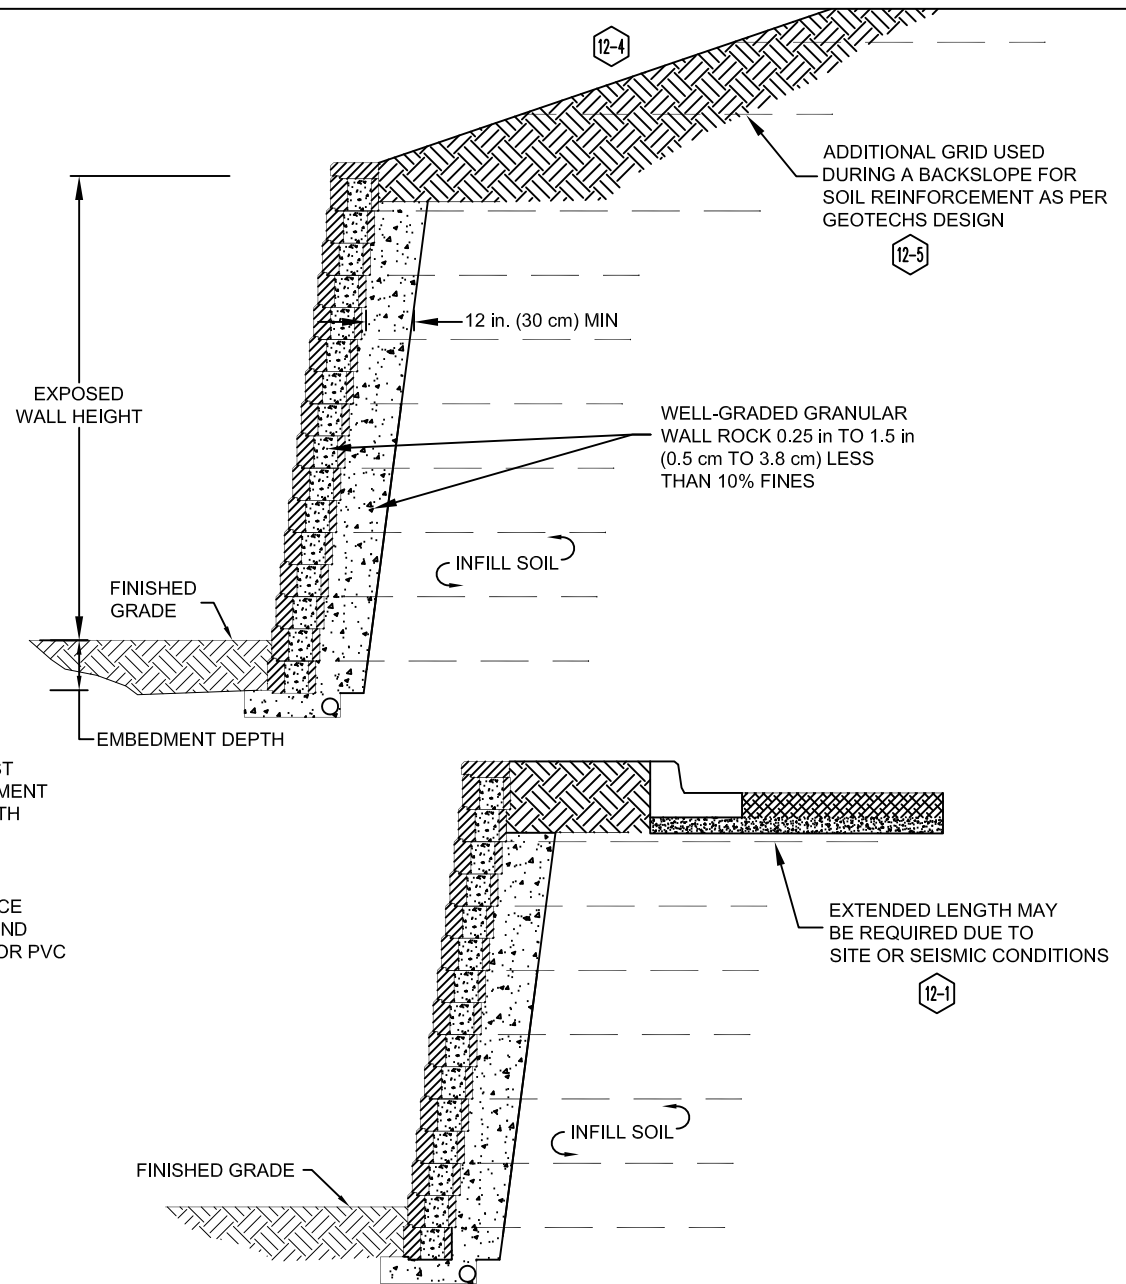


BEST PRACTICES NOTES:

- 12-1 GEOGRID LENGTH EXTENDED TO 90% WALL HEIGHT OR ADDITIONAL 3 ft (0.9 m) WHICH EVER IS GREATER (CHAPTER 12.1)
- 12-2 STRUCTURES SHOULD BE POSITIONED 3 ft (0.9 m) BEHIND THE TOP COURSE TO ALLOW PROPER OVERTURNING DESIGN (CHAPTER 12.2)
- 12-3 FENCE POSTS WITHIN 3 ft (0.9 m) NEED TO CONSIDER THE LOCAL OVERTURNING FORCES APPLIED TO THE WALL FACING (CHAPTER 12.2)
- 12-4 PROPER LIFT AND COMPACTION OF SLOPE SHOULD FOLLOW GEOTECHNICAL RECOMMENDATIONS (CHAPTER 12.3)
- 12-5 BACKSLOPES GREATER THAN 3:1 SHOULD INCLUDE REINFORCEMENT IN SLOPE USING GRID LENGTHS THAT MATCH THE STANDARD GRID LENGTHS IN THE WALL (CHAPTER 12.4)

* SEE BEST PRACTICES DOCUMENT CHAPTER 12.0 FOR MORE ABOVE WALL NOTES

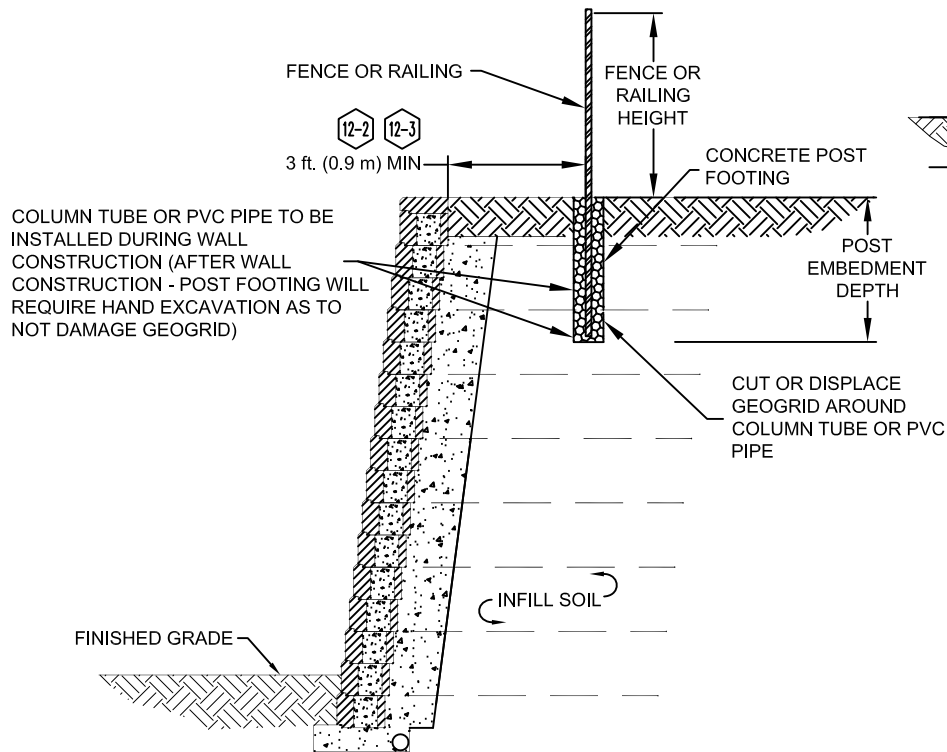

Designed By:
KAH

Title:

BEST PRACTICES ABOVE WALL CONSIDERATIONS

Date:
03/04/2014

Checked By:
RJL



This drawing should not be used for final design or construction without the certification of a professional engineer registered in the state in which the wall will be built. The accuracy and use of details contained in this document are the sole responsibility of the user. The user must verify each detail for accuracy as they pertain to their particular project.
© 2005 Allan Block

Project No:
I099.14

Scale:
NOT TO SCALE

Drawing No:
11